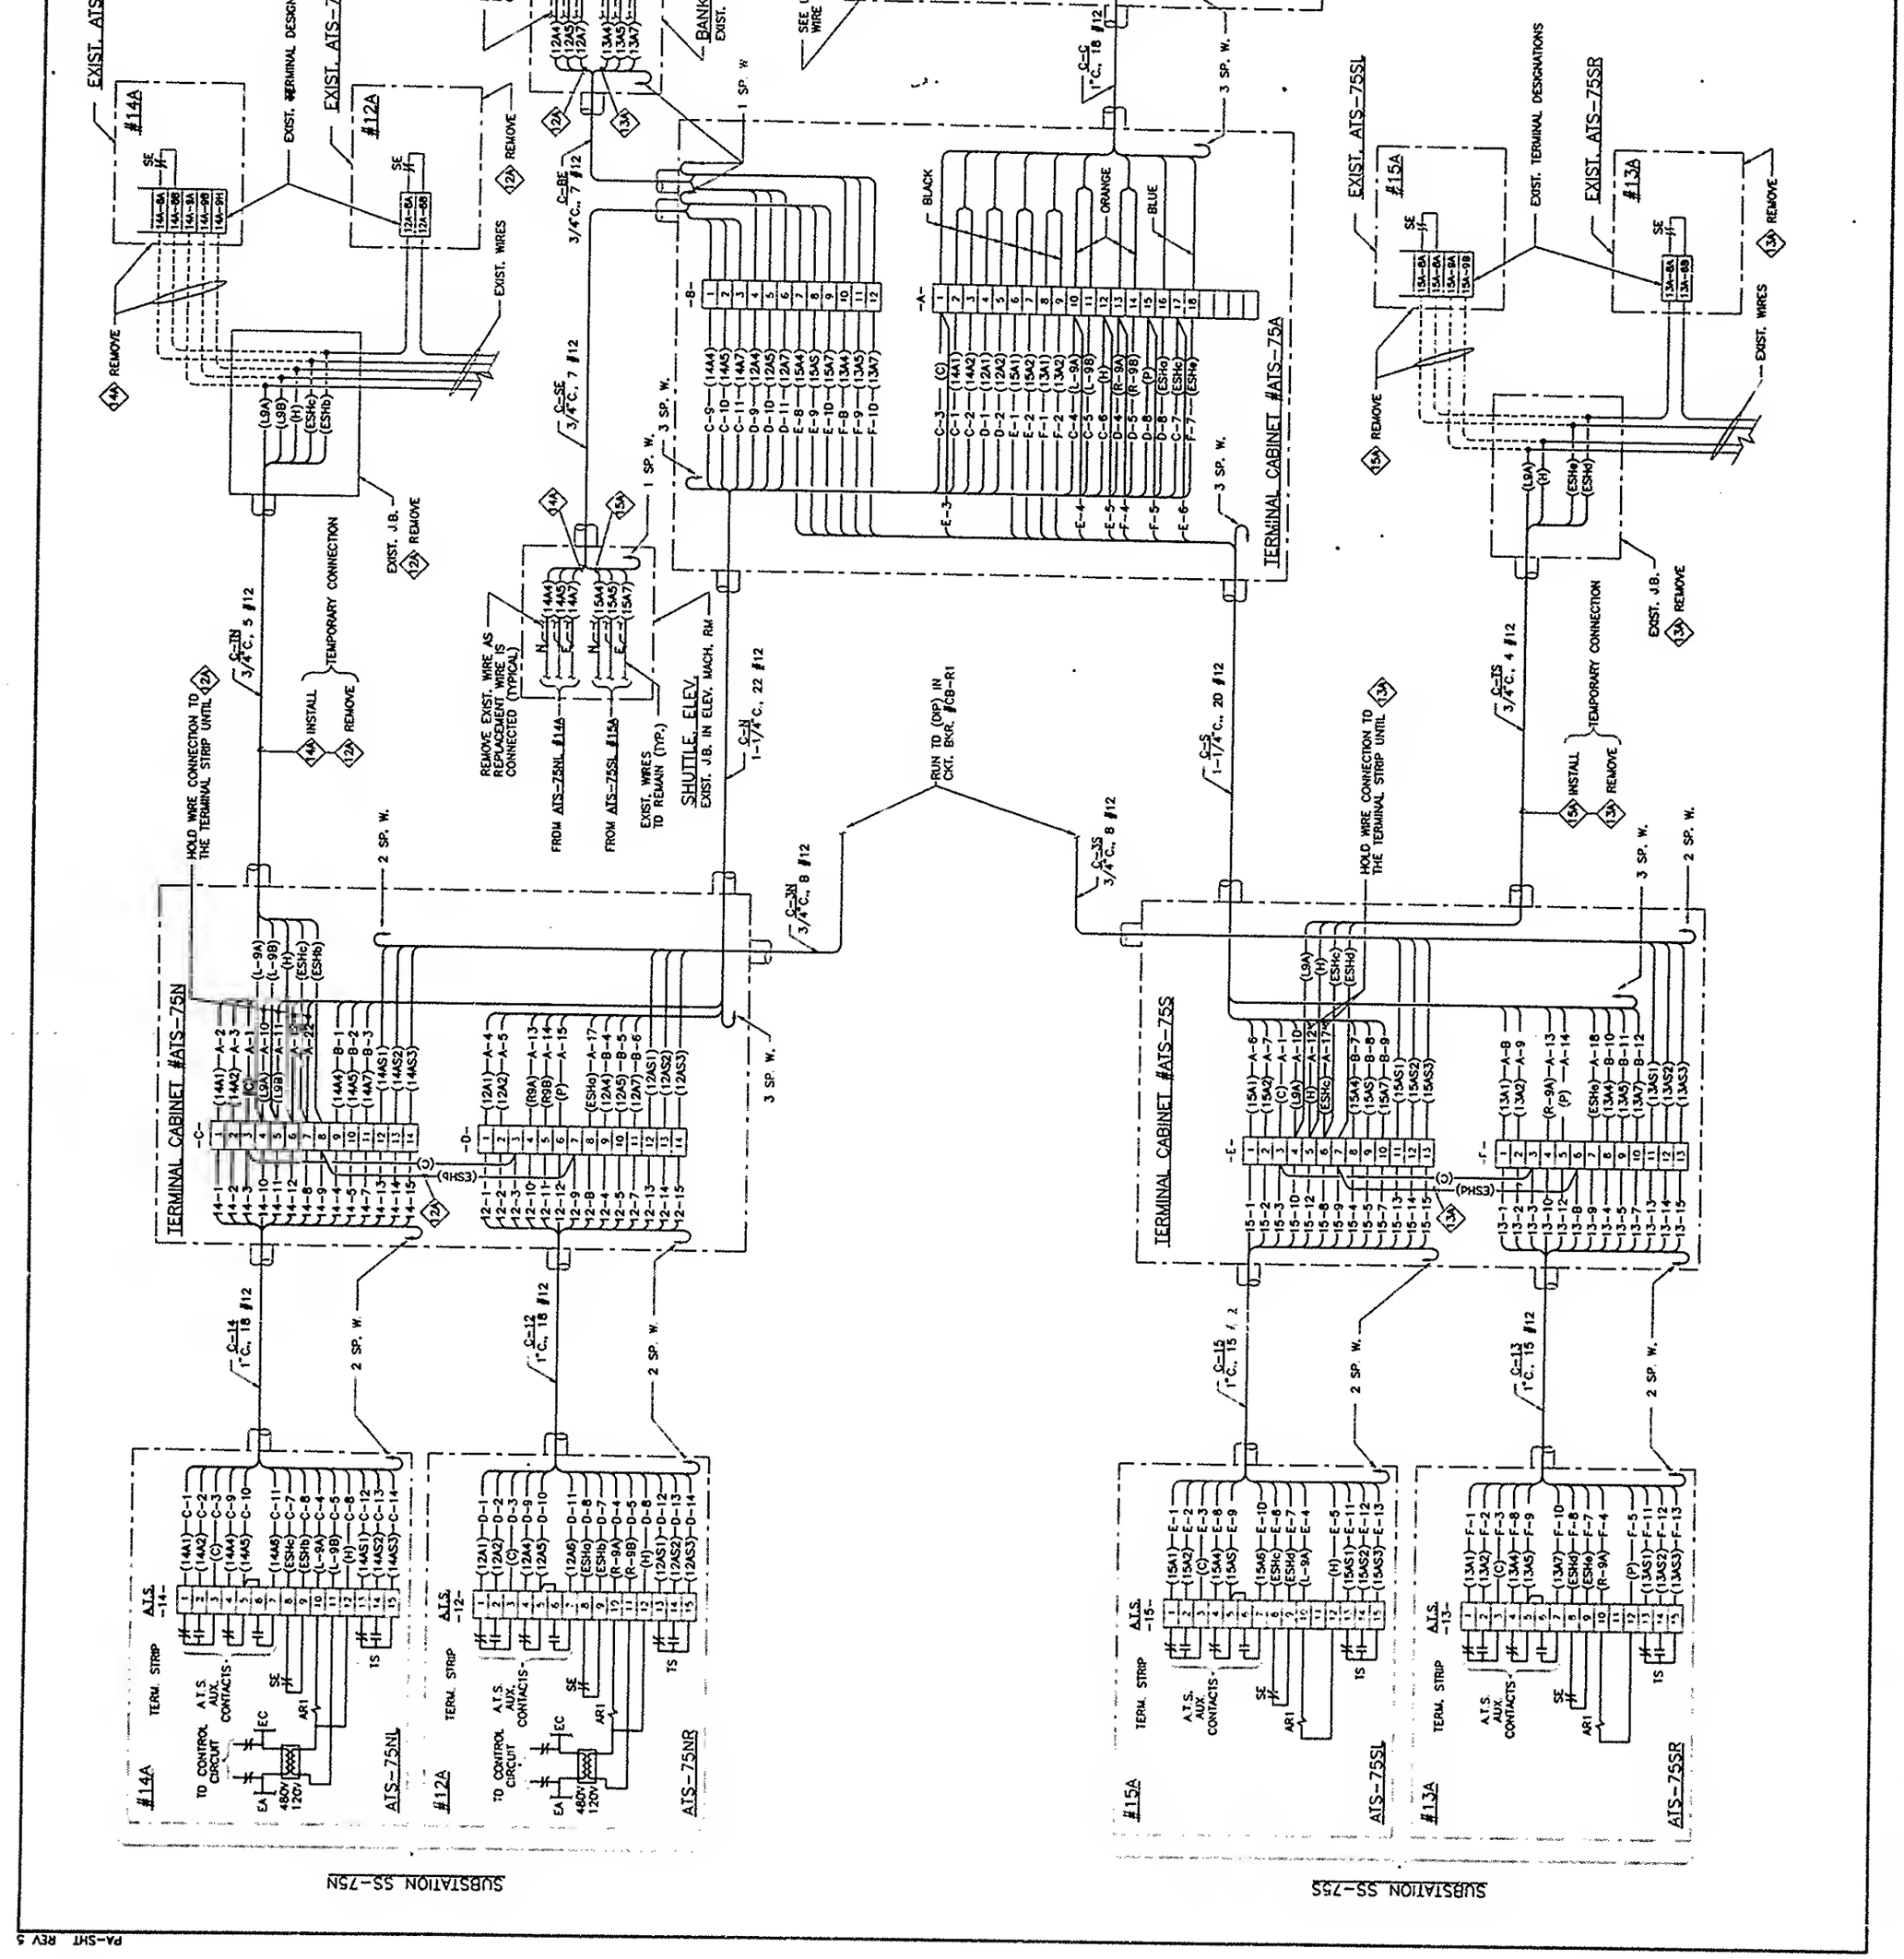
EXIST. ATS-75N
EXIST. TERMINAL DESIGNATIONS
#14A
#12A
EXIST. WIRES
REMOVE
EXIST. J.B.
TEMPORARY CONNECTION
INSTALL
REMOVE
HOLD WIRE CONNECTION TO THE TERMINAL STRIP UNTIL
3/4"C. 5 #12
3/4"C. 7 #12
3/4"C. 8 #12
1-1/4"C. 22 #12
1-1/4"C. 20 #12
1"C. 16 #12
1"C. 18 #12
2 SP. W.
3 SP. W.
1 SP. W.
REMOVE EXIST. WIRE AS REQUIRED. WIRE IS CONNECTED (TYPICAL)
FROM ATS-75NL #14A
FROM ATS-75SL #15A
EXIST. WIRES TO REMAIN (TYP.)
SHUTTLE ELEV.
EXIST. J.B. IN ELEV. MACH. RM
RUN TO (OPP.) IN CKT. BKR. #58-R1
TERMINAL CABINET #ATS-75N
TERMINAL CABINET #ATS-75S
TERMINAL CABINET #ATS-75A
EXIST. ATS-75SL
EXIST. ATS-75SR
#15A
#13A
BLACK
ORANGE
BLUE
TERM. STRIP
A.T.S. AUX. CONTACTS
TD CONTROL CIRCUIT
480V/120V
5A
EC
SE
AR1
TS
ATS-75NL
ATS-75NR
ATS-75SL
ATS-75SR
SUBSTATION SS-75N
SUBSTATION SS-75S

PA-SHT REV 4